

Central Analytical Laboratory

Test on GRP Water Tank Panel

Requestor: MEDMAC United Est. Gen. Trad. Cont.

Job No: 50-OS

Date Submitted: 05-01-2011

Date Finished: 24-01-2011


No of Sample(s): 01

Type of Sample (s): Panel

Methodology used: BS 6920, TOC (Combustion) FIA,
ICP-AES, ICP-MS, CV-AAS(Hg)

Analyst(s): Amina, Anwar

Approval

Section Head  QC/QA Unit Head 

Details about the sample, provided by the client.

Manufacturer : KORVAN Company Limited
Brand : Korvan
Origin : South Korea


The sample of total exposed area 20,000 mm² dipped in water at 50°C for 10 days, according to British Standard BS-6920, as per discussion with the client. Analysis made for toxic substances released into water:



Parameters	Amount released into water at 50°C
Total Organic Carbon (TOC), mg/L	0.48
Total Recoverable Phenols, mg/L	< 0.10
Toxic Metals	Concentration (mg/L)
Arsenic	< 0.01
Cadmium	< 0.001
Lead	< 0.01
Chromium	< 0.01
Selenium	< 0.01
Cobalt	< 0.01
Mercury (inorganic)	< 0.001
Nickel	< 0.01
Tin	< 0.05
Barium	< 0.05

No Liability

Neither Kuwait Institute for Scientific Research nor its employees give any warranty, express or implied or assumes any legal liability for the accuracy and utility of any information, material, output, process or data disclosed. They do not suggest that its use would not infringe upon Privately or Publicly owned rights.

Dr. Amal Al - Rashdan, Manager
Central Analytical Laboratory

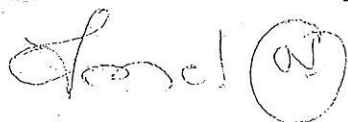



PUBLIC AUTHORITY FOR APPLIED EDUCATION & TRAINING (PAAET)
SHUWAIKH NEW CAMPUS PROJECTS

TRANSMISSION OF DRAWINGS, DOCUMENTS, SAMPLES, ETC.

Contractor: Real Estate Construction & Fabrication Co
Contract: Extension of College of Health Sciences - Girls
Contract No.: PA/AFA/113-2008/2009

CHS

To: A/E(ZCE) SITE OFFICE

WE ARE SENDING HEREWITH DOCUMENTS THAT COMPLIES WITH THE CONTRACT DOCUMENTS

Transmittal No.: CHS/SM/4155

Rev. 00



Date: 26/12/2011

1. SUBMITTED FOR	CODE
APPROVAL	1
YOUR INFORMATION	2
	3

2. ACTION	
APPROVED	A
APPROVED AS NOTED	B
NOT APPROVED	C
	D

SPEC. or BOQ. REF.	DRAWING NO.	QTY	ITEM SQ No.	DESCRIPTION	*TYPE	CODE	Action
III - 2		1	1	Sample Approval For	(SM)	1	B
15420				GRP Water Tank			
				Encl: 1 Samples + 5 Color photos			
				Make : Korvan-Korea			
				Location : Building 1&4- Shelter			
				Contractor: RECAFCO			
				Sub Contractor: M/s Drake & Scull International			
				Related Submittal :			
				CHS/MD/3671,RFAS-70 Rev.01			

CHS, PAAET MEP - DSK011
Distribution
PD
MP
PM
SM / CMF
P. Eng (Mech)
P. Eng (Elec)
QA / QC
HSE
QS
Planning
Procurement
Engineering
Site Admin
Site Serv

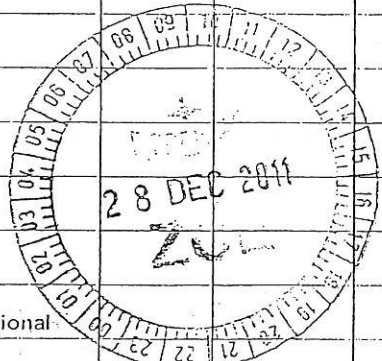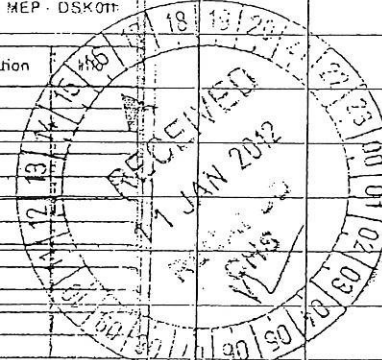

RECAFCO (Eng. Abdul Jawad Mohamed, Project Manager) Date: 26-12-2011


A/E to enter Action Codes and Remarks, and return to Contractor

REMARKS:

Action 'B' Approved As Noted

- GRP Water Tank made by (Korvan - Korea) is approved subject to
- Submit country of origin Certificate with the delivery note.
- Comply with the Contract Documents.

cc- Alaa
- IMR
- Fale

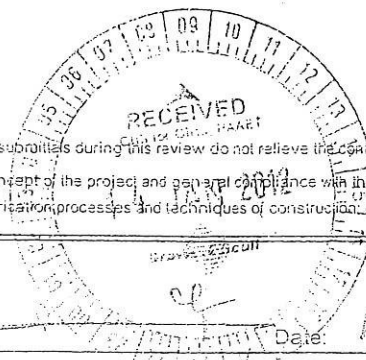

12/1/2012 D.S

Corrections or comments made relative to submittals during this review do not relieve the contractor from compliance with the requirements of the drawings and specifications. This is only for the purpose of general conformance with the design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for confirming and correlating all quantities and dimensions selecting fabrication processes and techniques of construction, coordinating his work with that of other trades, and performing his work in a safe and satisfactory manner.

For: A/E(ZCE)

Date: 10-1-12

COPIES	
PAAET (The Engineer)	
CM (TP)	
A/E (ZCE)	

Submittal (This is to be entered by Contractor)

Submittal Type: SD = Shop Drawing; SM = Samples; MS = Method Statement; SD = Submittal Data

SD = Method Statement; MS = Shop Drawing; SM = Samples; SD = Submittal Data

PUBLIC AUTHORITY FOR APPLIED EDUCATION & TRAINING (PAAET)
HUWAIKH NEW CAMPUS PROJECTS

TRANSMISSION OF DRAWINGS, DOCUMENTS, SAMPLES, ETC.

Contractor: Real Estate Construction & Fabrication Co

Contract: Nursing Institute

Contract No.: PA/AFA/112-2008/2009

Site: A/E (DAH)

SITE OFFICE



Transmittal No.: NI/MI/112/11



Rev. 00

Date: 28/04/11

1. SUBMITTED FOR	CODE
APPROVAL	1
YOUR INFORMATION	2
	3
2. ACTION	
APPROVED	A
APPROVED AS NOTED	(B)
NOT APPROVED	C
	D

WE ARE SENDING HERewith DOCUMENTS THAT COMPLIES WITH THE CONTRACT DOCUMENTS

SPEC. or BOQ. REF.	DRAWING NO.	QTY	ITEM SQ No.	DESCRIPTION	*TYPE	CODE	
						Submittal ¹	Action ²
15450		1+3	1	Material Data Approval for GRP Water Tanks	(MD)	(1)	B
				1) 10 x 5 x 2 mtr			
				2) 6 x 5 x 2 mtr			
				3) 2 x 2 x 2 mtr			
				Manufacturer: Korvan; Korea			
				Location/Building			
				Encl: Technical Data			
				Contractor: RECAFCO			
				Sub Contractor: M/s. Drake & Scull Int.			
				Related Submittal :			
				RFAS : 43 Rev, 01 dated 07/04/2011			

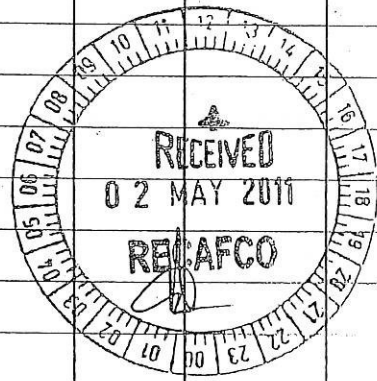

COPIES	
PAAET (The Engineer)	<input checked="" type="checkbox"/>
CM(TP)	<input checked="" type="checkbox"/>
A/E (DAH)	<input type="checkbox"/>

RECAFCO (Eng. Mohamed Abdul Kareem, Project Manager)

Date: 28/04/11

to enter Action Codes and Remarks, and return to Contractor

REMARKS:

Approved as Noted

Subject to approval of material at site and tank size 10X5X2 should be approved as per K.F.B approval.

Corrections or comments made relative to submittals during this review do not relieve the contractor from compliance with the requirements of the drawings and specifications. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the contract documents. The contractor is responsible for confirming and correlating all quantities and dimensions selecting fabrication processes and techniques of construction; coordinating his work with that of other trades, and performing his work in a safe and satisfactory manner.



For: A/E (DAH)

Date: 02/05/2011

COPIES	
PAAET (The Engineer)	<input checked="" type="checkbox"/>
CM (TP)	<input checked="" type="checkbox"/>
A/E (DAH)	<input type="checkbox"/>

Submittal Code to be entered by Contractor

Submittal Type: SD = Shop Drawing; SM = Samples; MS = Method Statement; MD - Manufacturer Data

Action Code to be entered by A/E

MU = Mock-up; SC = Supplier/Sub-contractor; OT = Others (OT = TT, CT, GT, WT)

SUBMITTAL FOR APPROVAL OF MATERIALS

CONSULTANT	Al Farooqi Engineering Consultant Bureau	Date	3	4	2011
-------------------	--	-------------	---	---	------

CONTRACTOR	Yusuf A. Alghanim & Sons W.L.L.	Ref	LULU	2011	PL&FF/12/R1
-------------------	---------------------------------	------------	------	------	-------------

1. MATERIAL DESCRIPTION: GRP TANKS	
Area of Application : ROOF FLOOR	
Drawing Ref. : LU-WS-04, LU-FP-04	B.O.Q. Ref. No. : PL-7/15-A,B , FF-12/9
Specification Ref. : 15420/2.01	Standards :
<input checked="" type="checkbox"/> M.D <input type="checkbox"/> Certificates <input type="checkbox"/> Tests <input type="checkbox"/> Mock Up <input type="checkbox"/> Sample <input type="checkbox"/> Method of Statement Report	

2. MANUFACTURER/SUPPLIER : KORVAN	
Company Name: KORVAN CO.	
Address : KOREA	
Local Agent : MEDMAK CO.	

3. DELIVERY :	
Country of Origin : KOREA	
Availability : Not available	
<input type="checkbox"/> Locally Manufactured	<input checked="" type="checkbox"/> Over Seas

C . Program :			
Ex-works/ Total Duration	[]	[]	
Estimated Time of Arrival on Site	[12 WEEKS]		
Date Material Required on Site	[]		
Latest Date for Order	[]		

CONTRACTOR	Eng / H. HANON	Signature	[Signature]	Date	3/4/2011
-------------------	----------------	-----------	-------------	------	----------

We certify that the above submitted items have been reviewed in detail and are correct and in strict conformity with the contract drawings and specifications except as otherwise stated; also that the material sources indicated above have been reviewed in detail and that they will supply the submitted items in conformity with the above and deliver same timely.

<p>13</p> <p>Refer to comments on sheet attached</p> <p>all installation work shall be under manufacturer Recommendation</p> <p>any time delay shall be Contractor Responsibility</p> <p>[Signature]</p>	<input type="checkbox"/> Approved
	<input checked="" type="checkbox"/> Approved As Noted
	<input type="checkbox"/> Revise & Resubmit
	<input type="checkbox"/> Rejected
	<input type="checkbox"/> Sample Required
	<input type="checkbox"/> Tests Required
	<input type="checkbox"/> Additional Information Required
	<input type="checkbox"/> Manufacturer's Guarantee Required


Approval shall not relieve Contractor of his liabilities under the Contract or constitute authorization of any change to Contract Documents

CONSULTANT	Eng / Hussam Jawad	Signature	[Signature]	Date	12-4-2011
OWNER REP.	Eng / Shateeh	Signature	[Signature]	Date	12-4-2011

Received

Date: 4/4/2011

9-30



Connections

Trading & Contracting Co. W.L.L.

شركة إنترناشيونال كونكشنز
التجارة والمقاولات ذ.م.م.

المحترمين
المحترم

الرقم (952)
التاريخ 2011/01/25
السادة / دار صالح القلاف للإستشارات الهندسية
عناية المهندس / صالح حسين يوسف القلاف
تحية طيبة وبعد ،،،

الموضوع / توريد وتركيب خزان G.R.P كوري المنشأ
للقسمة رقم (1547) به بطاقة الري - ملف رقم 1796 / ص

بالإشارة إلى الموضوع أعلاه والحقا لكا. إننا رقم (951) المرسل لكم بتاريخ 2011/01/23 نحيطكم علما بأنه لا مانع لدينا من توريد وتركيب الخزان موضوع العقد كوري المنشأ إنتاج Korvan علما بأن شركتنا تكفل الخزان لمدة عشرين سوات و نتعهد بتقديم كفالة المورد وذلك بعد الإنتهاء من أعمال الفحص والتركيب الخاصة بالخزان .


يرجى سرعة الرد والإفادة حيث أنه تم تحديد موعد للكشف على القسمة من الإدارة العامة للإطفاء لإستلام وتشغيل معدات مكافحة وإذار الحريق وذلك يوم الخميس الموافق 2011/02/10 .
كذلك يرجى التنبيه على مقاول أعمال التهوية الميكانيكية بسرعة الإنتهاء من أعمال توريد وتركيب وتشغيل مراوح التهوية الميكانيكية حتى نتا. كن من تسليم كافة الأعمال التي تخص الإدارة العامة للإطفاء.

كذلك يتعين على مقاول أعمال التهوية الميكانيكية الحضور يوم الفحص ومعة المخططات والكتالوجات المعتمدة لأعمال التهوية الميكانيكية حتى يتسنى لنا تسليم وتشغيل كافة المعدات بدون ملاحظات ومن ثم إستخراج كتاب إيصال التيسار .

لإعانة من توريد الخزائن المذكورة
شرط تقديم كفالة
و تقضائا بقبول وافر التحية ،،،
شاكرين لحسن تعاونكم معنا ،،،

من شركة إنترناشيونال لمدة عشرين سوات
وتقدم كفالة من المورد شاملة للمالكين ويكون
كامل لمدة عشرين سوات مع كافة فواتير

2011/01/25




Connections


عن شركة إنترناشيونال كونكشنز
مهندس / السيد سلامة
رئيس قسم الإطفاء
Tel: 66955608

25/01/2011

e-mail: info@connections-tuwait.com

تلفون : ٢٤٧٢٣٤١ (٩٦٥) - فاكس : ٢٤٧٢٣١٢ (٩٦٥) ص ب ٢٨٠١١ الصفاة ١٣١٠١ - دولة الكويت
Tel.: (965) 2472341 - Fax: (965) 2472342 - P.O. Box 28011, Safat - 13101, State of Kuwait

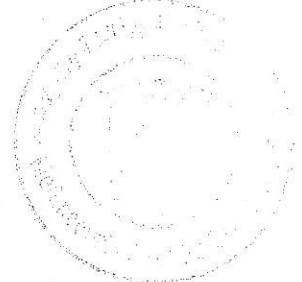



Submittal Form

Date: (التاريخ) : 07/07/2008

1/5

Project Title (اسم المشروع) : Residential Tower in Fintas (space).
Owner (المالك) : A'ayan Real State.
Consultant (الاستشاري) : Luay Ahmed Al - Saleh Architectural.
Contractor (المقاول) : Construction management and building Co. (CMBC).

SUBMITTAL No. : 224
SUBMITTAL TITLE : Plumbing System-Material.

REVISION : 1

We are sending ☐ herewith ☐ under separate cover the drawings/documents listed below:

Item No.	Quantity	Description	Type	Submittal Code	Action Code
1	15420	Glass Reinforced Plastic Tank (GRP) Make : Korvan, Korea. Size : 5X3X4 (on roof) Size : 5X3X3 (on roof) Size : 5X2X1.5 (In Basement) * Please find attached Catalogue, Test Report & Local Approval in Kuwait for more details.	MD		(B) Approved as Noted

LAB REVIEW COMMENTS :

(1) All stainless steel parts shall be conforming to BS 5750 Grade 316L

(2) Coordinate with civil works for standard foundation

(3) submitte Equipment plane in mechanical room.

Corrections or comments made relative to submittals during this review do not relieve the Contractor from compliance with the requirements of the drawings and specifications. This check is only for review of general conformance with the design concept of the project and general compliance with the information given in the Contract Documents. The Contractor is responsible for confirming and correlating all quantities and dimensions, selecting fabrication processes and techniques of construction; coordinating his work with that of other trades and performing his work in a safe and satisfactory manner.

ENGINEER'S SIGNATURE

RETURNED

DATE

07/07/2008


TYPE
SD: Shop drawings
MT: Material
GT: Guarantee
MD: Manufacturer's Data
CT: Certificate
SC: Subcontractor
OT: Other

SUBMITTAL CODE:

- 1: Submitted for Approval
- 2: Submitted your information

ACTION CODE:

- A: Approved
- B: Approved as Noted
- C: Not Approved
- D: For information



Consultant: HUSAIN SALAMAH CONSULTANT OFI

Contractor: AL-BAHAR CONSTRUCTION CO.


TRANSMITTAL FORM

Transmittal No.: 47 Rev.:



(Engineer to enter ACTION code)

RE's Remarks

1. The source is approved.
2. Tank size will be approved as per site condition.
3. Submit Tank Foundation details for approval.



Corrections or comments made relative to the submission during this review does not relieve the Contractor from compliance with the requirements of the drawing Specifications. This check is only for review of general concept of the project and general compliance with the information given in the contract documents. The Contractor is responsible for confirming and correlating selection, fabrication process and techniques of construction, coordinating his work with that of other trades and performing in a safe and satisfactory manner.

		Issued By : (Resident Engineer)	
		Copy	Name
Owner's Representative	<input checked="" type="checkbox"/>	Signature : 	Date :
Resident Engineer	<input checked="" type="checkbox"/>		2-1-2019
Contractor	<input checked="" type="checkbox"/>		Time :
Received by the Contractor		Signature :	
Name		Date :	
		Time :	

Project: AWTAD COMPLEX - AL FINTAS

اسم المشروع : مركز اوتاد التجاري بالفطيان

Materials Transmittal

طلب اعتماد مواد

TO :

السيد / المهندس / المقيم

مكتب المصمم للاستشارات الهندسية

A: Approved
B: Approved As Noted
C: Not Approved
D: For Information

CONTRACTOR:

KUWAIT CONTRACTORS.Trad.& Cont. Co.

DATE :

المقاول شركة كويت كونتراتكترز للتجارة العامة والمقاولات

التاريخ 3/5/2008

Transmittal No. : رقم التلايم		13		Revision.: 00	
Transmittal Title : الموضوع		طلب اعتماد جزاء الحرس			
Item No.	Dwgs. Specs. BOQ Ref.	Description	Type	Copies	Action
			الترميز	عدد النسخ	الاجراء
SM Sample MD Manufacturer's Data CT Certificate TT Tests GT Guarantee CAT Catalog OT Others					
1		G.R.P tank for fire fitting (KORVAN)			
		Dimensions (10x5x2)			
We certify that the materials submitted here with have been reviewed and are in conformance with the contract drawings and specifications except as otherwise stated نقر بان المواد المقدمة اعلاه قد تم مراجعتها والتأكد من انها مطابقة لمخططات ومميزات ومواصفات عقد المفاوضة، عدا ما هو غير ذلك منصوص عليه					
Contractor's representative			Received:		
Date: 3/5/2008			Date: 3/5/2008		
Review comments: الملاحظات					


1. The source is approved.

2. The Tank size should be as per KEB's approved

8 site conditions.

7-5-08

OWNER	Resident Engineer	Received by Contractor
Date: التاريخ	Date: التاريخ	Date: التاريخ
Distribution: التوزيع <input type="checkbox"/> السك <input type="checkbox"/>	الاستشاري <input type="checkbox"/> Consultant	8/5/2008

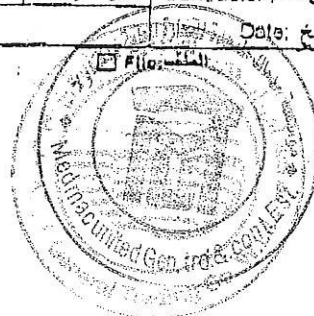

14

طلب اعتماد مواد

137

اليوم التعاقدى :

تاريخ التقديم : 20 / 01 / 2028

أخرى ☐كهرباء ☐تكيف ☐صحي ☐مدني ☒

مرفق عينة / كتالوج الشركة المنتجة للمواد الآتي تفصيلها للتدقيق والاعتماد

م	بيان المواد	رقم البند	بلد المنشأ	رأي المهندس (معتمد/مرفوض)	الملاحظات
1	خزانات مياه من إقايير جلد من إقايير (ص. 100)	(8)			حرق الخزانات للصيانة المختلفة
1.1	KORVAN		Korea		دماغ من إقايير خزانات KORVAN
1.2	SEJIN		Korea		شريط ان تكون درع من إقايير
1.3	شركة مصنع لإقايير		Kuwait الكويت		

التاريخ : 20 / 01 / 2028

تاريخ الإستلام : 20 / 10 / 2028

توقيع

توقيع

ممثل المتعهد :

المهندس المقيم

التوزيع الداخلي

تاريخ الاستلام : 20 / 1 / 1

تاريخ التسليم : 20 / 01 / 19

توقيع :-

بيانات الأفادة

ممثل المقاول (المستلم)

المهندس المقيم

الاسم :

التاريخ :


التوقيع :

الاسم :

التاريخ :

التوقيع :

طلب اعتماد مواد
صحي



شركة مداخل العقارية
Madakheh Real Estate Co.

المشروع:	انشاء و انجاز و صيانته برج الحمام بمنطقة القبلة	رقم الطلب:	PL MD 09
المقاول:	شركة الزامل والدياسطي لمقاولات البناء	تاريخ التقديم:	/ /

A: لا مانع
B: لا مانع مع ملاحظات
C: غير موافق
D: تم العلم
R: إعادة التقديم

GRP domestic water tank

KORVAN

WATER SUPPLY SYSTEM AT ROOF FLOOR

اسم المادة:

المصدر:

المورد:

مكان الاستخدام:

رقم التفتيش	مراجع المخططات، المواصفات، جداول الكميات	الوصف	النوعية	عدد النسخ
SM Sample OT Others	MD Manufacturer's Data MS Method Statement	CT Certificate PD Pre-qualification document	TT Tests	GT Guarantee
	CAT Catalog			

1	MD	GRP domestic water tank SIZE 12 X 2.5 X 2	DIV 15	
			PAG 13	
			ITEM P	

نقر نحن المقاول بأن المواد المقدمة قد تمت مراجعتها وبيانها متطابقة مع مستندات ووثائق العقد إلا إذا ذكر خلاف ذلك

مدير المشروع ممثل المقاول:	استلام ممثل المالك:	التاريخ:	29 / 6 / 08
الملاحظات:	مع حفظ حق المالك في صرف المخرطة للمقاول	التاريخ:	29 / 6 / 08

الملاحظات: (مع حفظ حق المالك في صرف المخرطة للمقاول)
KORVAN
صيانة لمبنى شركة مداخل العقارية
للمبنى رقم 12 خ 2.5 خ 2
تقديم خطة تنفيذ لوجستية لخدمة المالك
30 / 6 / 08 قبل طلب الترخيص

ممثل المالك:	استلام المقاول:	التاريخ:	30 / 6 / 08
التاريخ:	30 / 6 / 08	التاريخ:	30 / 6 / 08



التوزيع: ☐ ممثل المالك ☐ الاستشاري ☐ المقاول

طلب اعتماد مواد			
المقاول الرئيسي : شركة بيان الوطنية التجارية			
العقد رقم : ص / م / م / 234 / 2007 - 45 / 2008			
المشروع الوطني لتأهيل المستشفيات - المرحلة الثانية - المجموعة الثامنة / منطقة الفروانية			
رقم طلب الاعتماد : FF-025			
نوع الأعمال : أعمال مكافحة الحريق			
العينة المطلوب اعتمادها : GRP tanks			
رقم أمر العمل : 13/م/ك/ت/2009			
اسم أمر العمل : إنشاء وانجاز مبنى توسعة العيادات الخارجية			
معتمد : A : معتمد مع ملاحظات : B : غير معتمد : C : استكمال معلومات : D :			
النتيجة	رقم البند	بيان وصف بند العمل	ملاحظات
(A)	بند رقم (13/1)	GRP tanks [2 nos.] Size 6*5*2 for fire fighting work Manufacture: KORVAN Korea supplied Med more written C.O.	
استلام الوزارة			
التاريخ : 01/09/07			
ملاحظات :			
<div style="display: flex; justify-content: space-between;"> <div> <p>ممثل المقاول غدا 27/4/2006</p> <p>التاريخ</p> <p>رئيس مكتب الشؤون الهندسية</p> <p>التاريخ</p> </div> <div> <p>مهندس الوزارة المختص</p> <p>2006</p> <p>التاريخ</p> </div> <div> <p>استلام ممثل المقاول</p> <p>3/10/2006</p> <p>التاريخ</p> </div> </div>			

مقاول الباطن: ٠١٤٤

٠١٤٤

تشي أعمال مدنية / صحي / كهرباء / تكييف / مصاعد / تش

قسم القبول
العدد
٢٠٠٨ / ٥٦ / ١٣٥
٢٠٠٨ / ١ / ١

تاريخ التقديم
(٥/٤/٤)

طلب اعتماد البنود التالية:

ملاحظات	المرجع التوعاقد	عدد النسخ	الجهة المصنعة / بلد المنشأ	الوصف	رقم
	قائمة الكميات	مخطط رقم			
	Section - 5440 - 7000	(2)	EBARA	Lifting Pump	(1)
	Section - 5440 - 7000	(2)	A.O Smith	Electric water Heater	(2)
	Section - 5440 - 7000	(2)	Korvan company Ltd.	G-RP water Tank	(3)
	استلام ممثل المالك / الاستشاري:				
٢٠٠٨ / ٦ / ١	التاريخ:	٢٠٠٨ / ٦ / ١	ممثل المقاول الرئيسي - حدائق	KKC	مقاول الباطن: ٢٠٠٨ / ٥٦ / ١٣٥
()	شهادات ()	مواد ()	عينات ()	مخططات ()	المرفقات: مخططات ()

() يعتمد وفقاً للملاحظات () يعتمد ()

The submitted items mentioned above (1, 2, 3) are accepted

1. EBARA Lifting Pump 2. A.O Smith Elect. Water Heater 3. Korvan G.R.P water tank Approved Capacity and all requirements shall be as per specs and REF & NEW

استلام ممثل مقاول الباطن: ٢٠٠٨ / ٦ / ١
التاريخ: ٢٠٠٨ / ٦ / ١

استلام ممثل المقاول: ٢٠٠٨ / ٦ / ١
التاريخ: ٢٠٠٨ / ٦ / ١

استلام ممثل المالك / الاستشاري: ٢٠٠٨ / ٦ / ١
التاريخ: ٢٠٠٨ / ٦ / ١

Materials Transmittal

طلب اعتماد مواد

Project: AWTAD COMPLEX - AL FINTAS

اسم المشروع : مركز أوتاد التجاري بالفنتاس

TO :

إلى: المهندس المقيم

مكتب الطين للاستشارات الهندسية

A: Approved
B: Approved As Noted
C: Not Approved
D: For Information

CONTRACTOR:

KUWAIT CONTRACTORS.Trad.& Cont. Co.

DATE :

المقاول شركة كويت كونتراكتورز للتجارة العامة والمقاولات

التاريخ 3/5/2008

Transmittal No. : رقم التقديم	13	Revision.: ٥٥
Transmittal Title : الموضوع طلب اعتماد كذا المصير		
Dwgs, Specs, BOQ Ref.	Description الوصف	Type النوع
Sample MD Manufacturer's Data CT Certificate TT Tests GT Guarantee CAT Catalog OT Others		Copies عدد النسخ
		Action الاجراء
G.R.P. tank for water supply		
Dimension (5X5X2)		

That the materials submitted here with have been reviewed and are in conformance with the contract drawings and specification s except as otherwise stated
نقر بأن المواد المقدمة أعلاه قد تم مراجعتها والتأكد من أنها مطابقة لمخططات ومستندات ومواصفات عقد المقاول، عدا ما هو غير ذلك منصوص

Contractor's Representative	Received: المستلم
3/5/2008 التاريخ	3/5/2008 التاريخ

Remarks: الملاحظات

Source is approved subjected To submit The following

1- MPW approval.

2- Lab Test results for water poisoning

- The size should be confirmed as per site condition - 7-5-8

Resident Engineer	Received by Contractor: ممثل المتعهد
Date: التاريخ	Date: التاريخ 3/5/2008

Distribution: المالك ☐ التوزيعConsultant الاستشاري ☐